



END ELEVATION

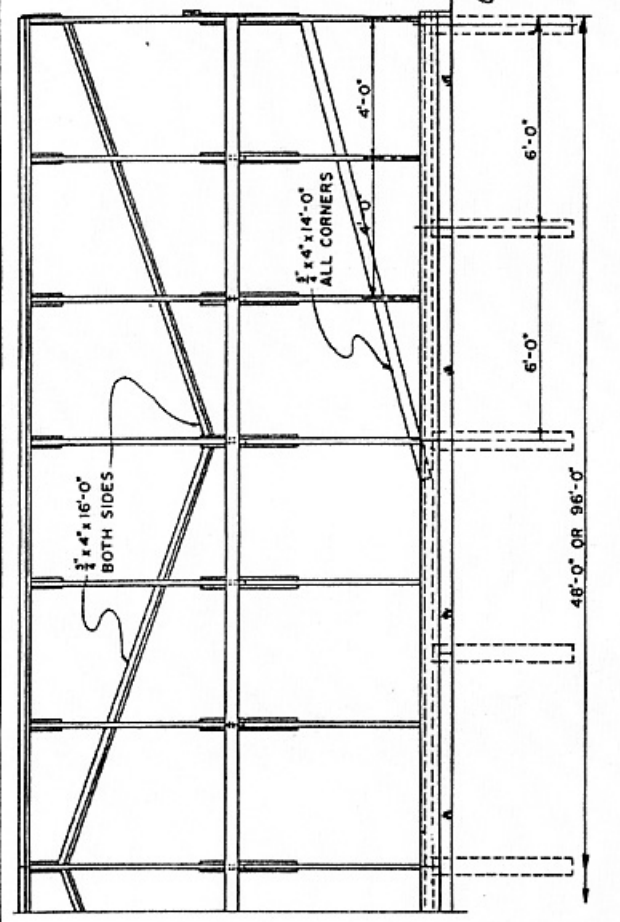

SIDE ELEVATION

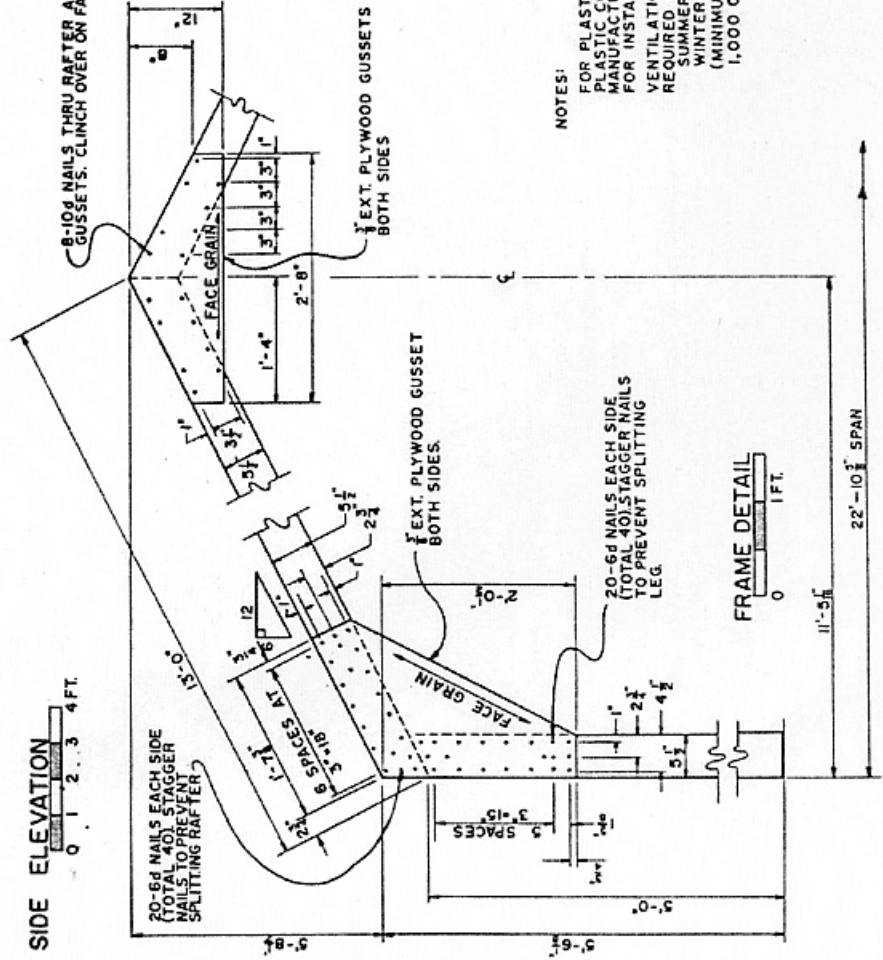

NOTES:
 FOR PLASTIC FILM AND RIGID PLASTIC COVERING FOLLOW MANUFACTURER'S DIRECTIONS FOR INSTALLATION.
 VENTILATION AND HEATING:
 REQUIRED FOR 23 x 48 HOUSE:
 SUMMER VENTILATION - 10,000 CFM
 WINTER VENTILATION - 660 CFM
 (MINIMUM AIR INTAKE - ONE SQ. FT. PER 1,000 CFM)

PERSPECTIVE

